SAFETYFirst
- PERSONAL ACCOUNTABILITY
- ACTIVE CARING
- HAZARD RECOGNITION

USP: Add Up Stream Protection, Facility ID, and Blocking Devise Type
USP: FUSE - 38952582
USP: FUSE - 38539528
USP: RECLOSER - 38998999
USP:

CIRCLE FOR SAFETY — DUKE ENERGY

Safety Reminders / Adverse Conditions

?: INSTALL NEW 500 KVA 277/480 PAD TX
?: INSTALL NEW UG PRI FROM POLE TO NEW TX
?: CONTINUE UG PRI TO NEXT PAD TX TO CLOSE LOOP
?: INSTALL FUSES ON SOUTH SIDE OF 3RD ST

Work Zone General Comments:
OFF SHOULDER WORK

REMEMBER: Work zone area conditions may have changed for this job! Everyone is responsible for verifying the above safety information is correct prior to any work being performed each day.

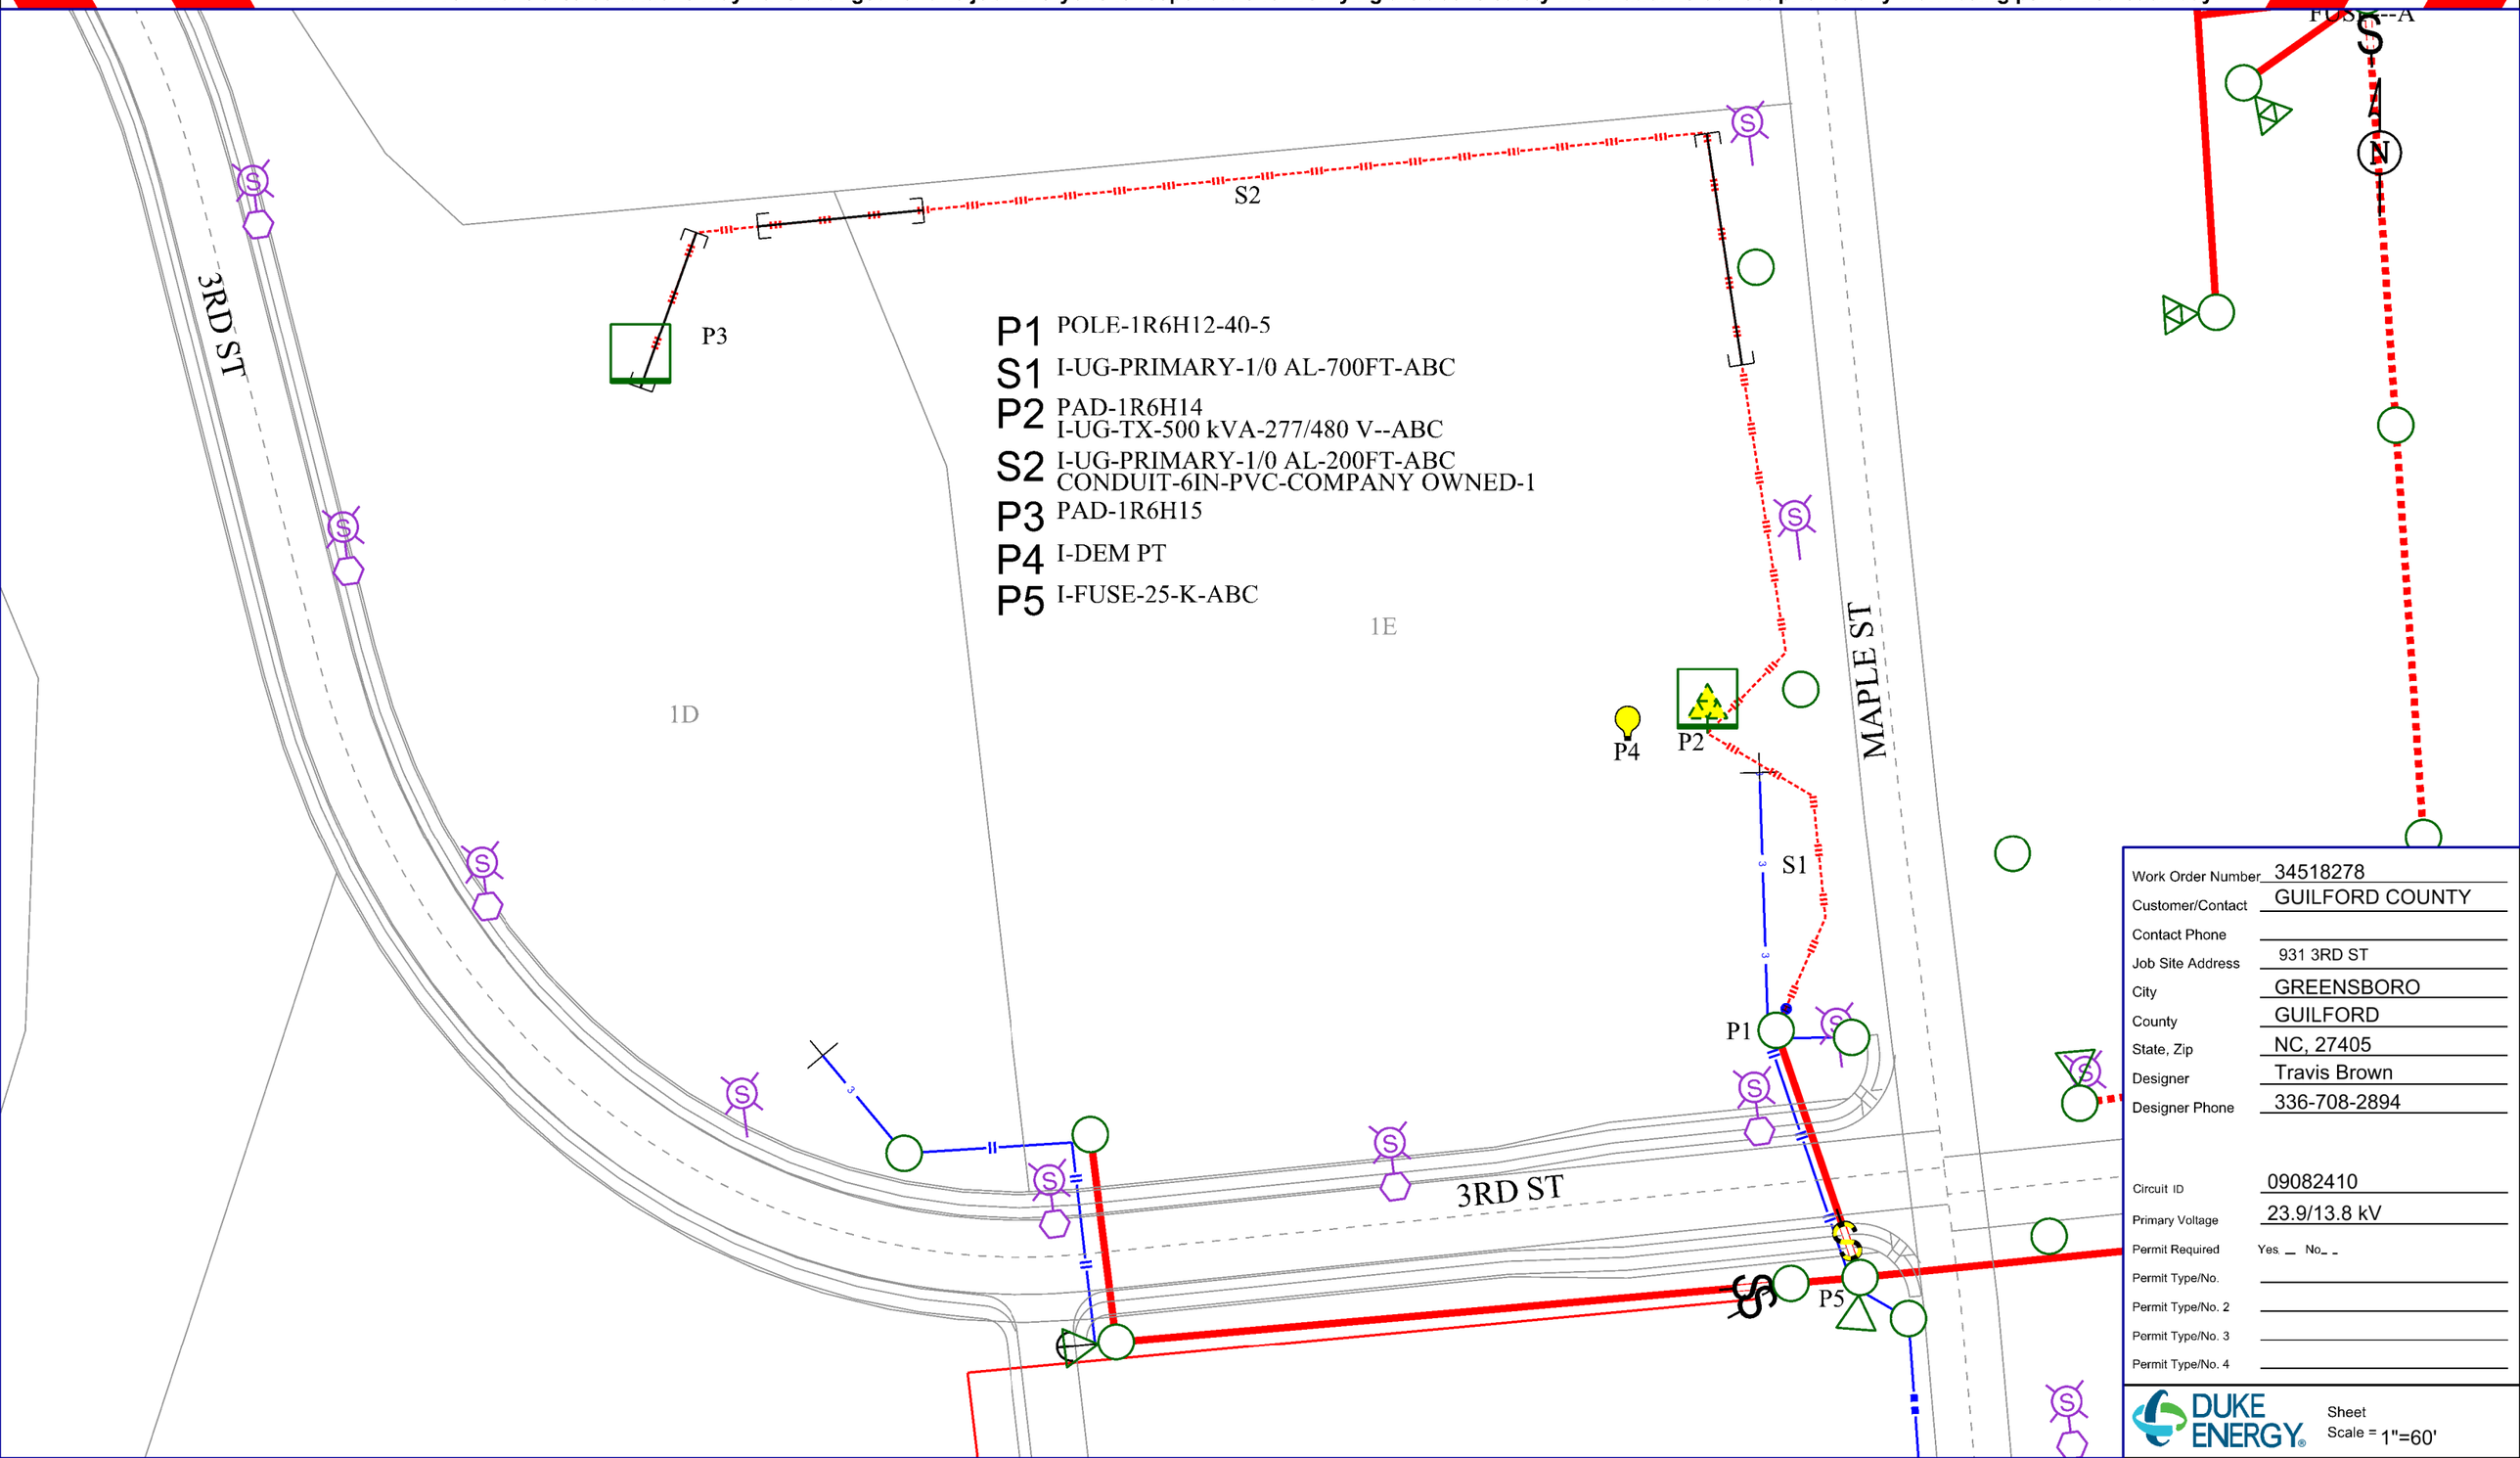

Work Order Number	34518278
Customer/Contact	GUILFORD COUNTY
Contact Phone	
Job Site Address	931 3RD ST
City	GREENSBORO
County	GUILFORD
State, Zip	NC, 27405
Designer	Travis Brown
Designer Phone	336-708-2894
Circuit ID	09082410
Primary Voltage	23.9/13.8 kV
Permit Required	Yes __ No__ _
Permit Type/No.	
Permit Type/No. 2	
Permit Type/No. 3	
Permit Type/No. 4	

DUKE ENERGY.

Sheet
Scale = 1"=60'